


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

LID LABELED "WATER", BROOKS No. 3RT OR CHRISTY OR APPROVED EQUAL

- NOTE: 1. GATE VALVES SHALL BE RESILIENT WEDGE VALVES OR APPROVED EQUAL.
2. ALL BOLTS AND NUTS SHALL BE GALVANIZED.
3. ALL VALVES SHALL BE WRAPPED WITH 30 MIL. PLASTIC AND TAPED

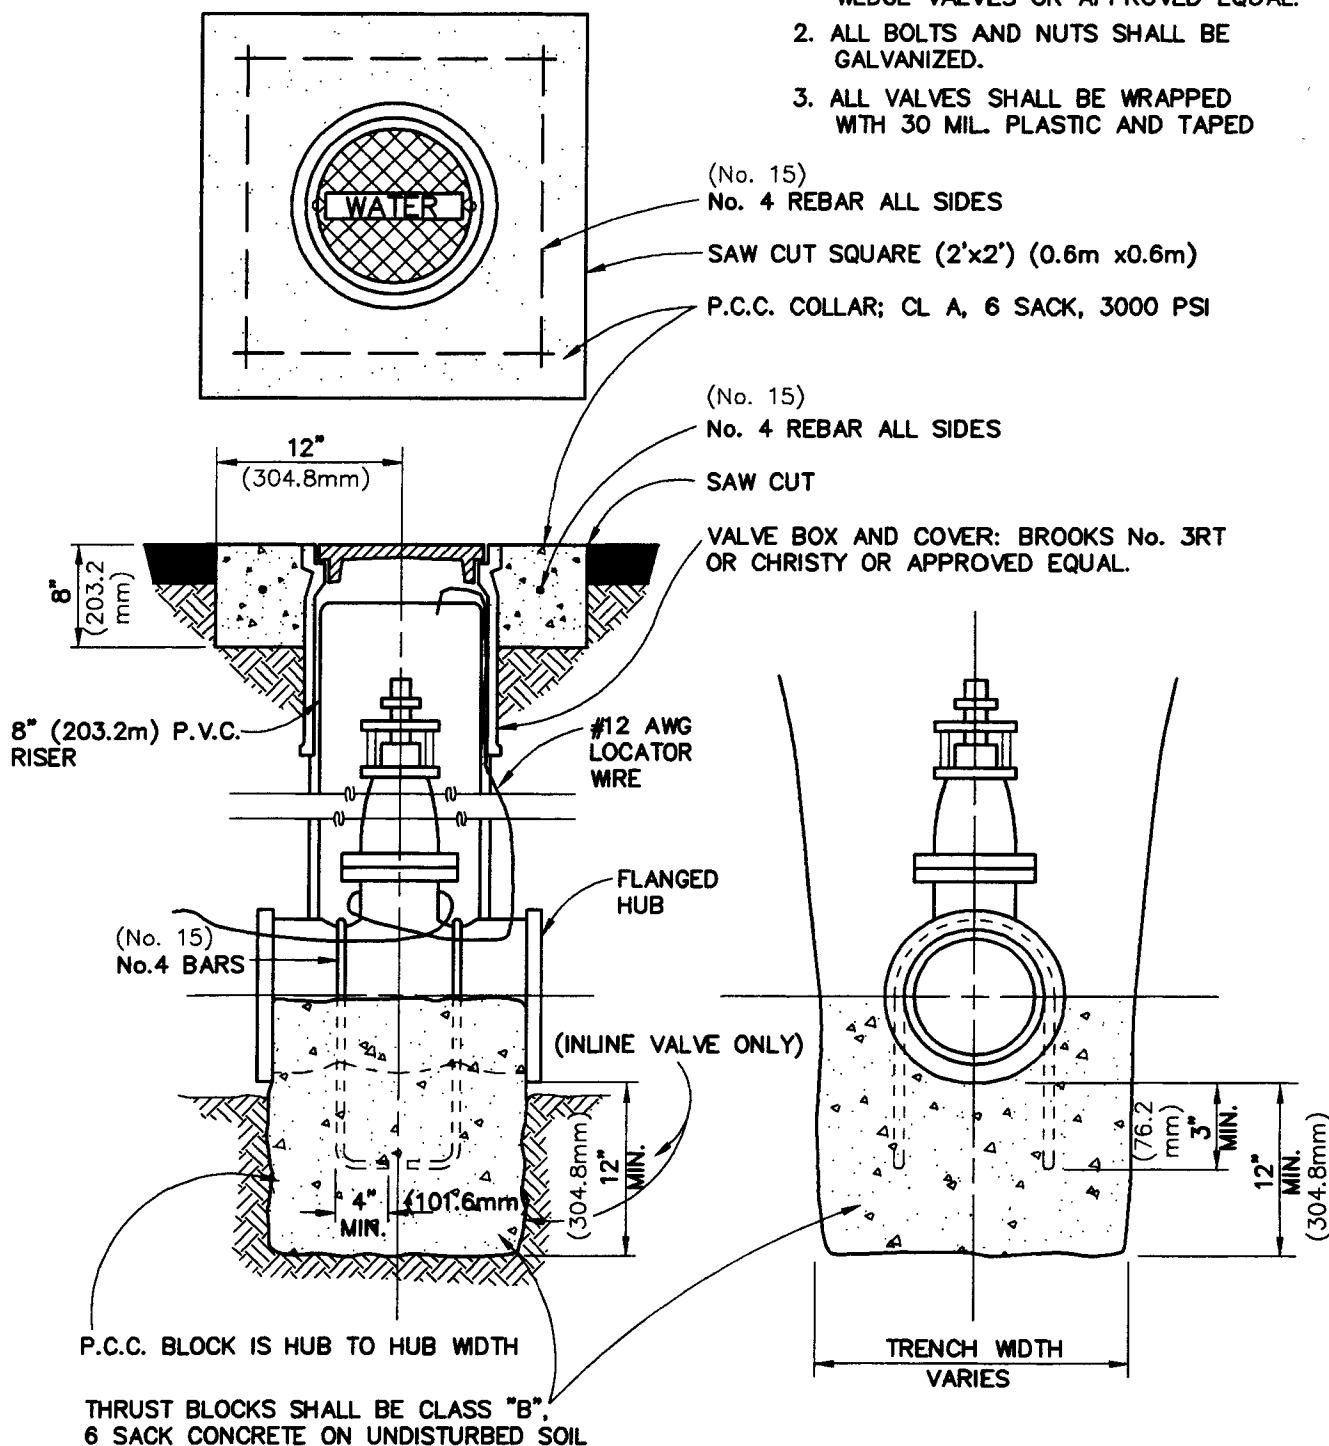

DRAWN BY:
C.A.C.
DESIGNED BY:

CITY OF PASO ROBLES
ENGINEERING DIVISION

DRAWING NO.

DATE:
4/18/94
FILE NAME:
PR-G-3.DWG

GATE VALVE BOX & ANCHOR

G-3